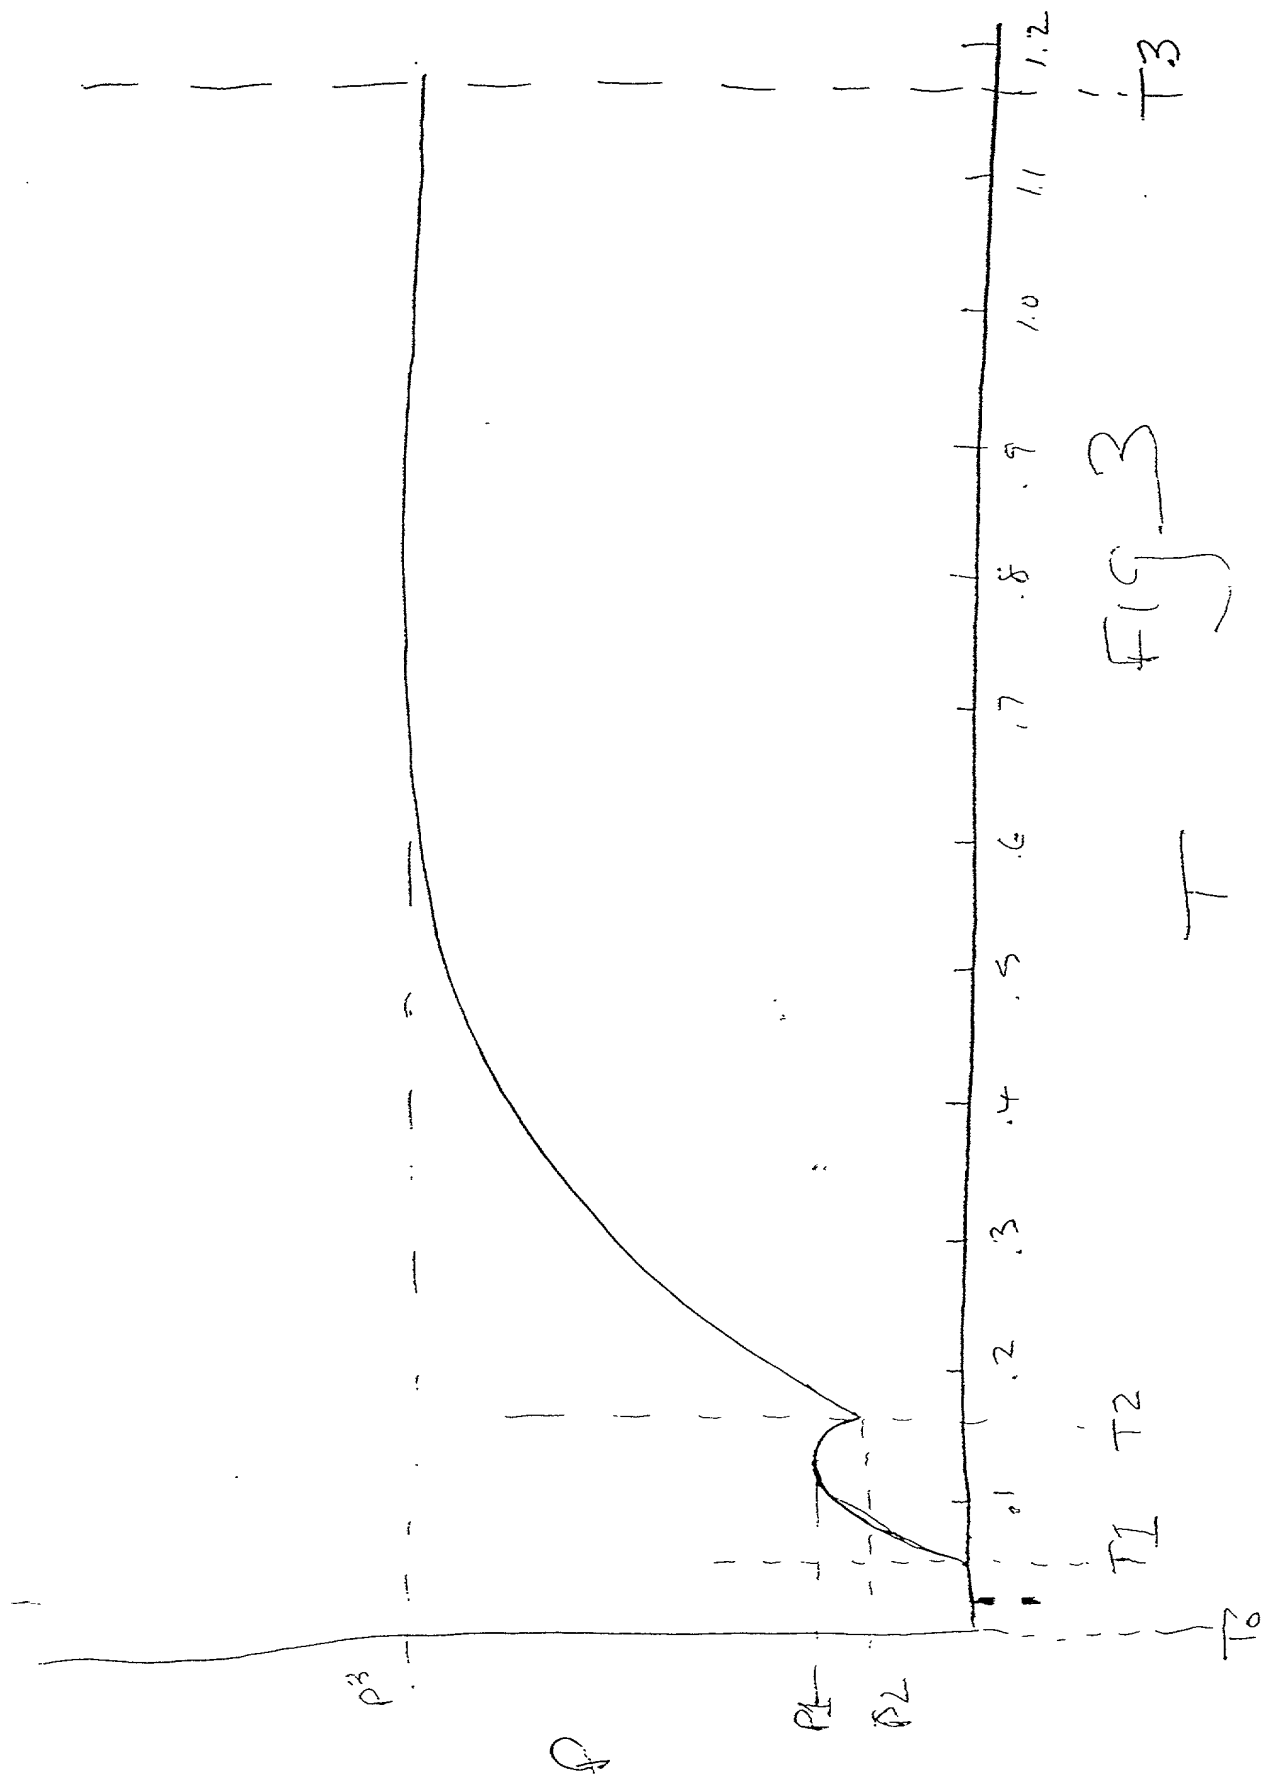
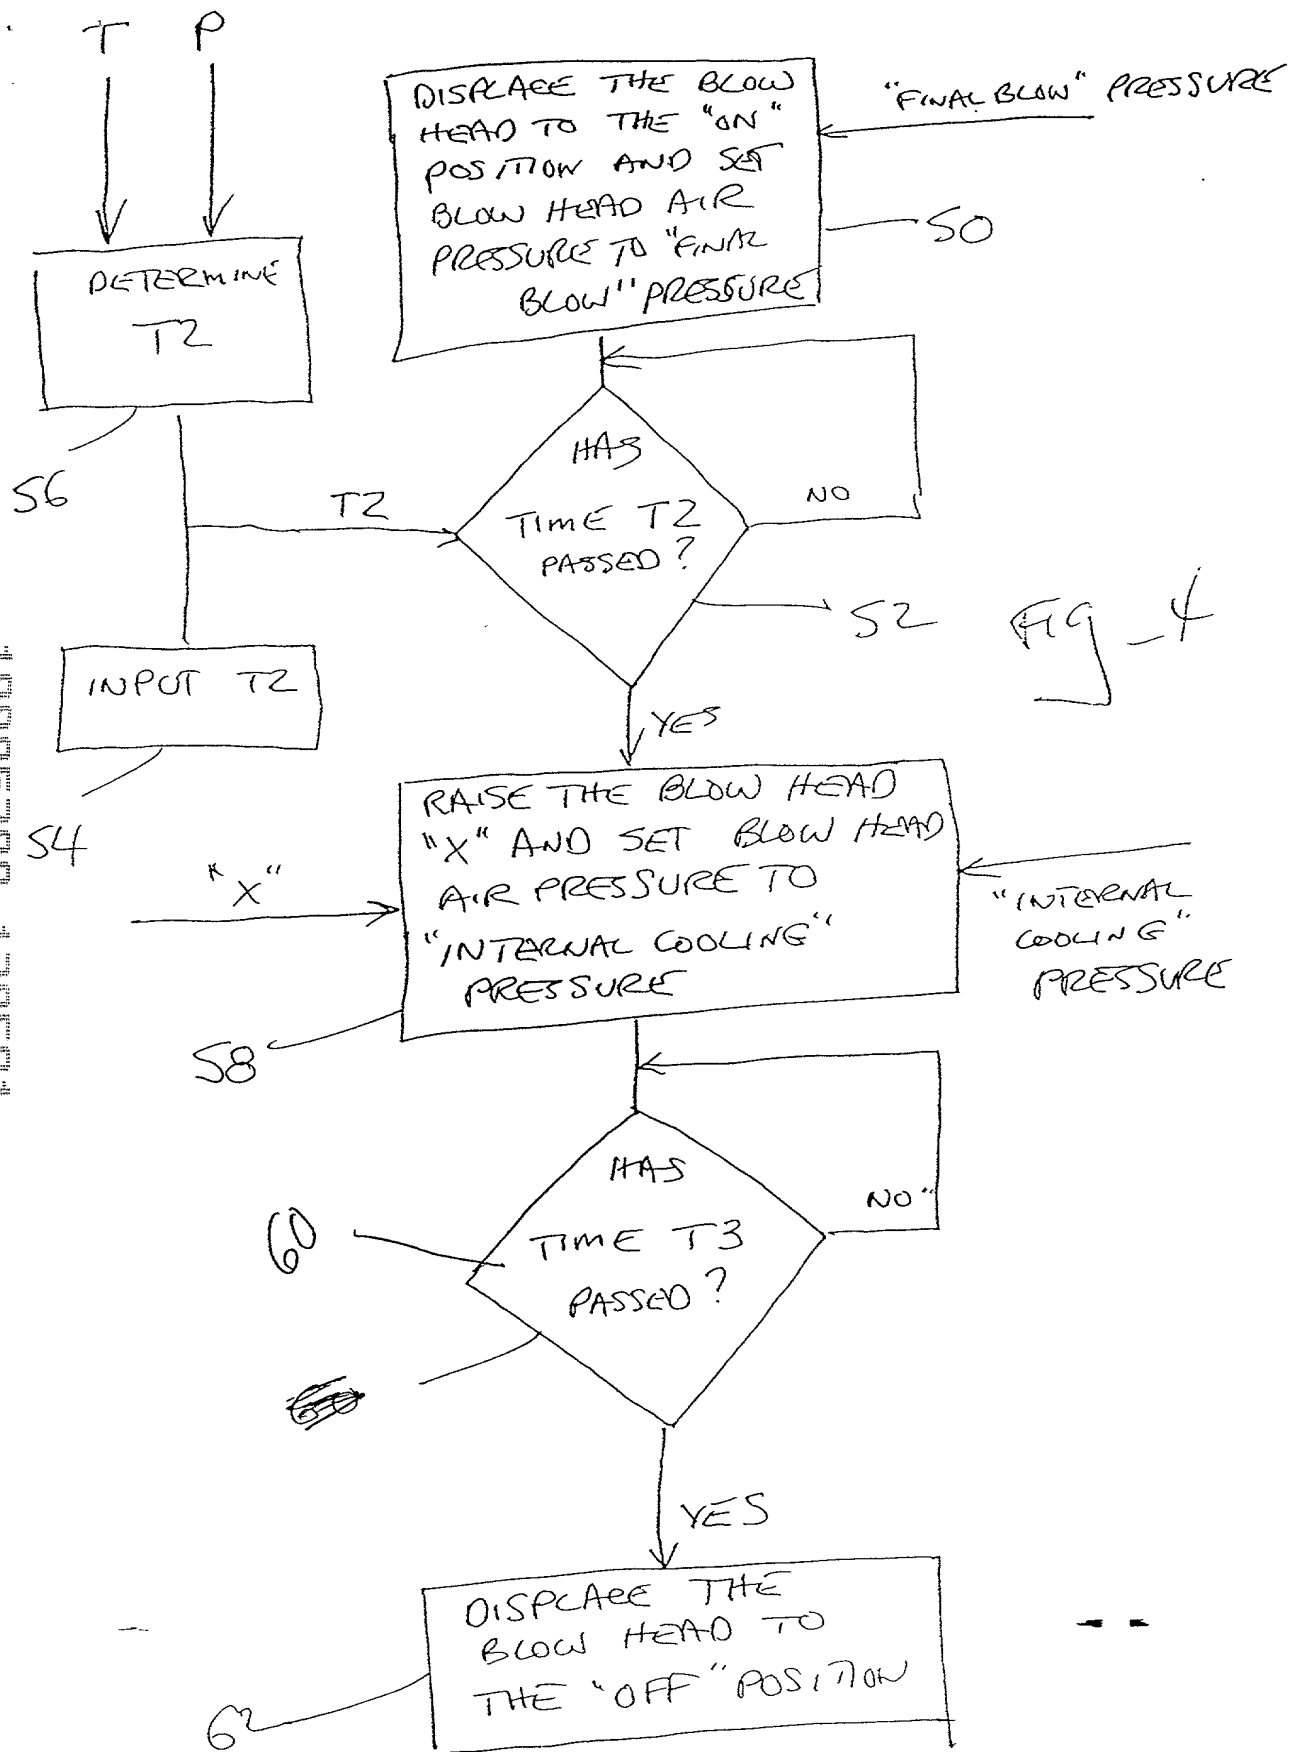
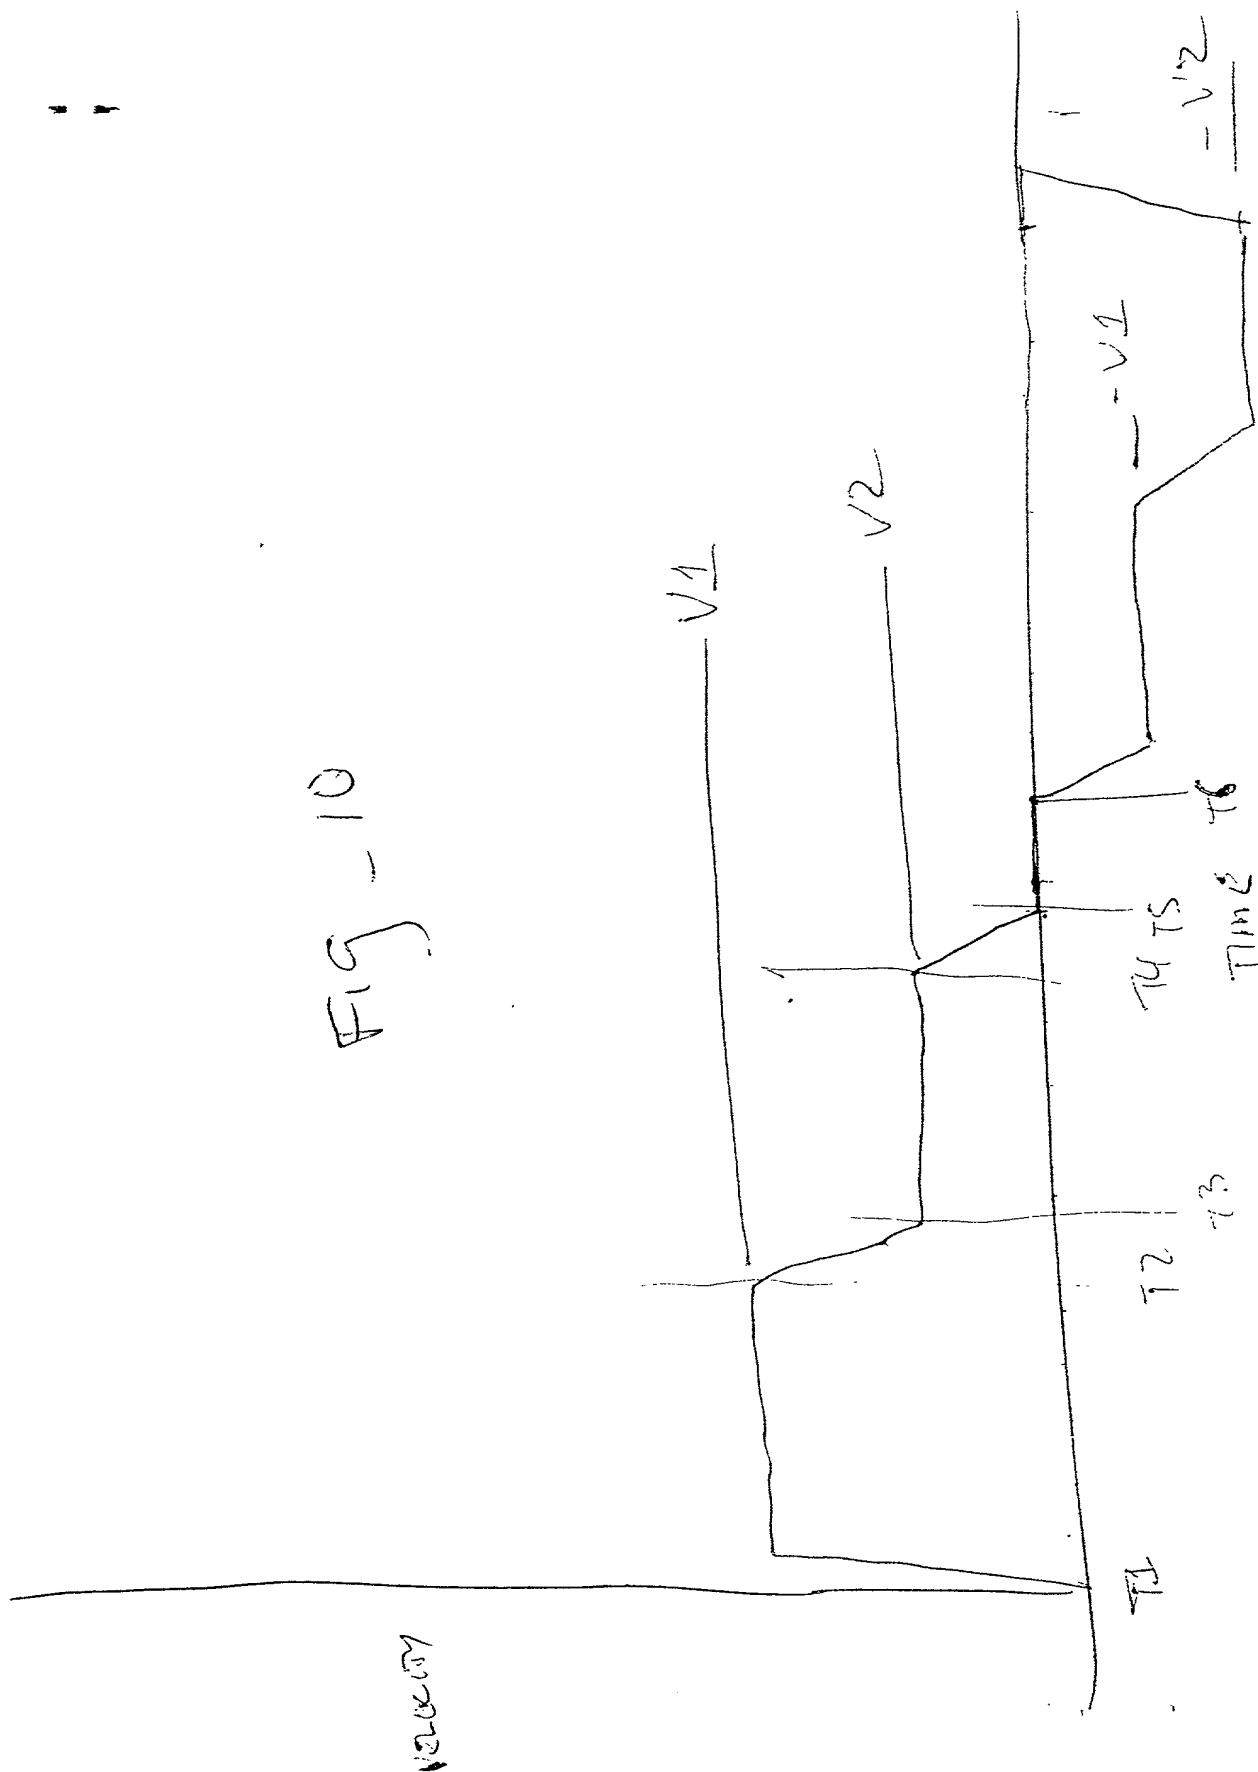
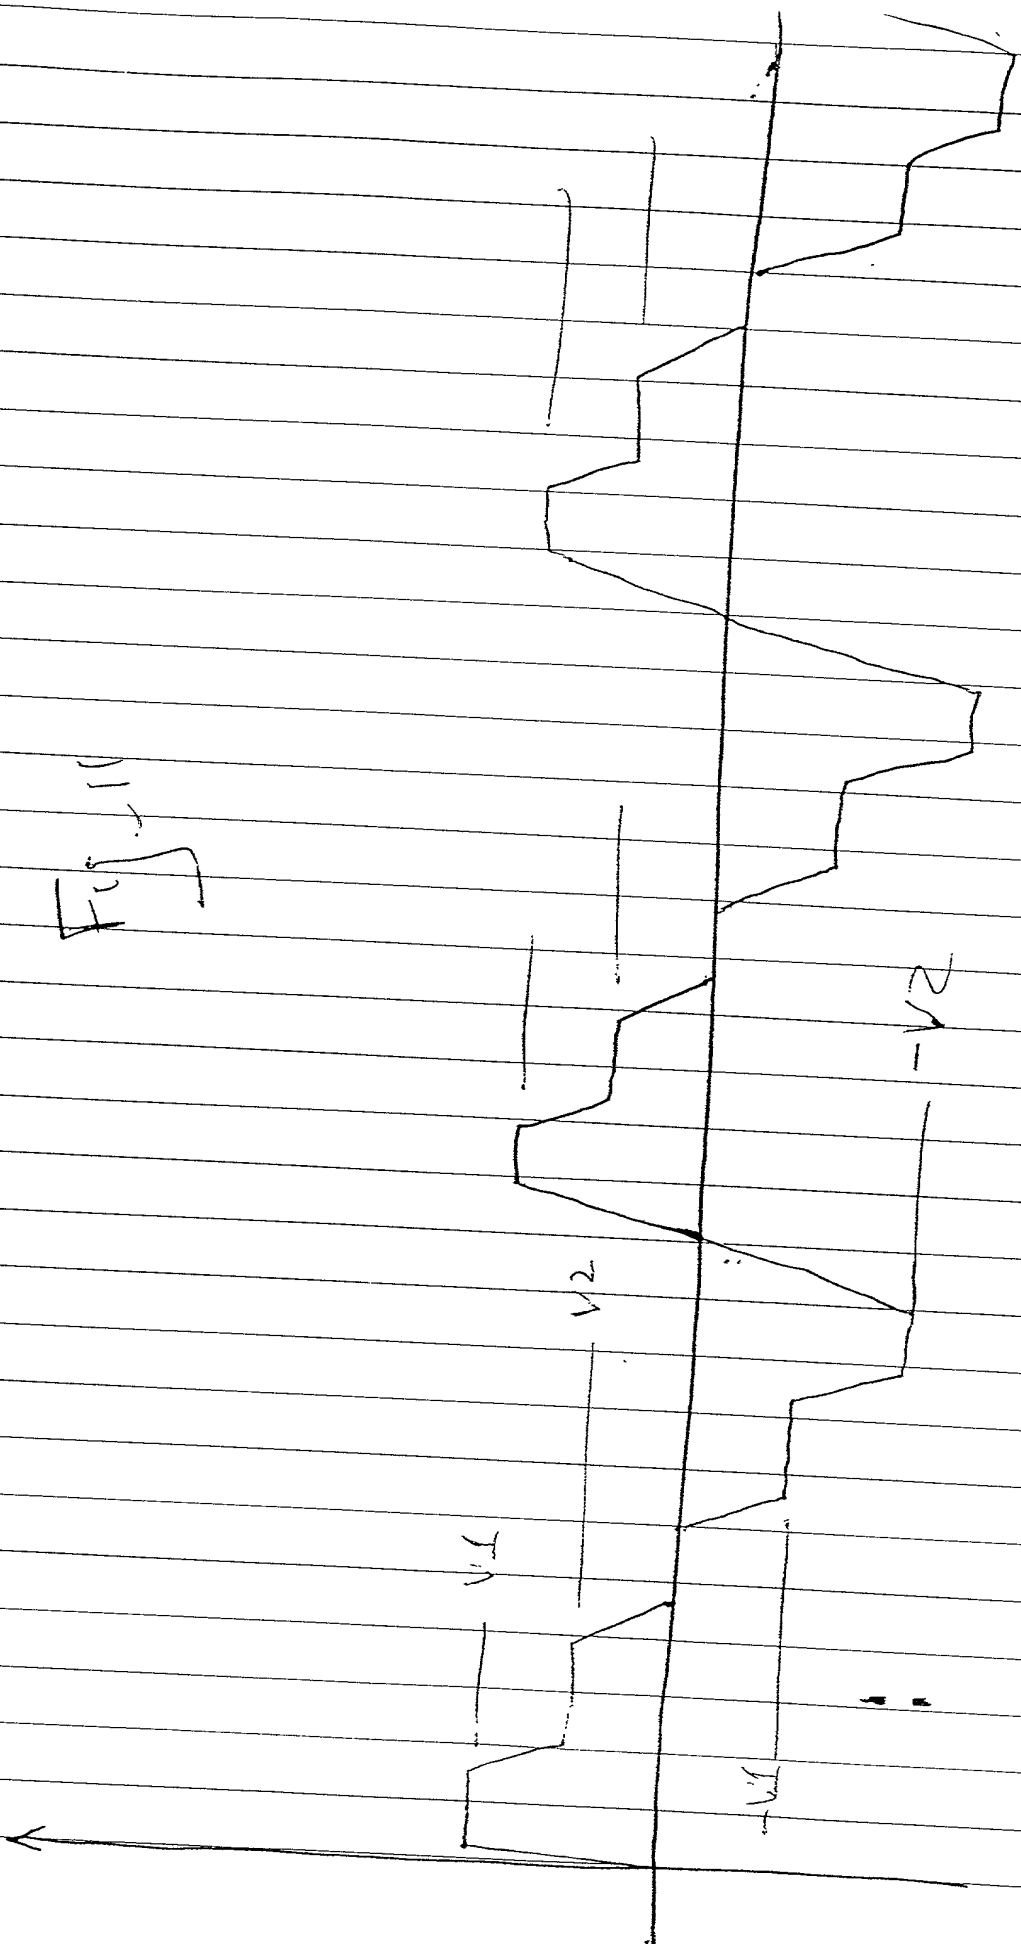



THE
NEW
YORK
PUBLIC
LIBRARY










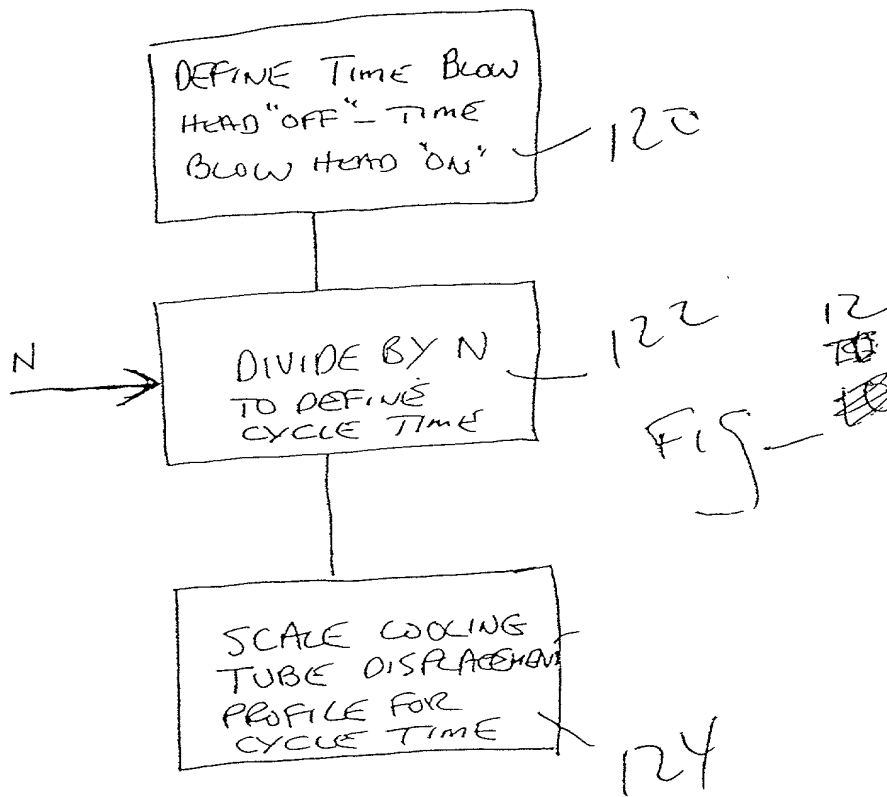

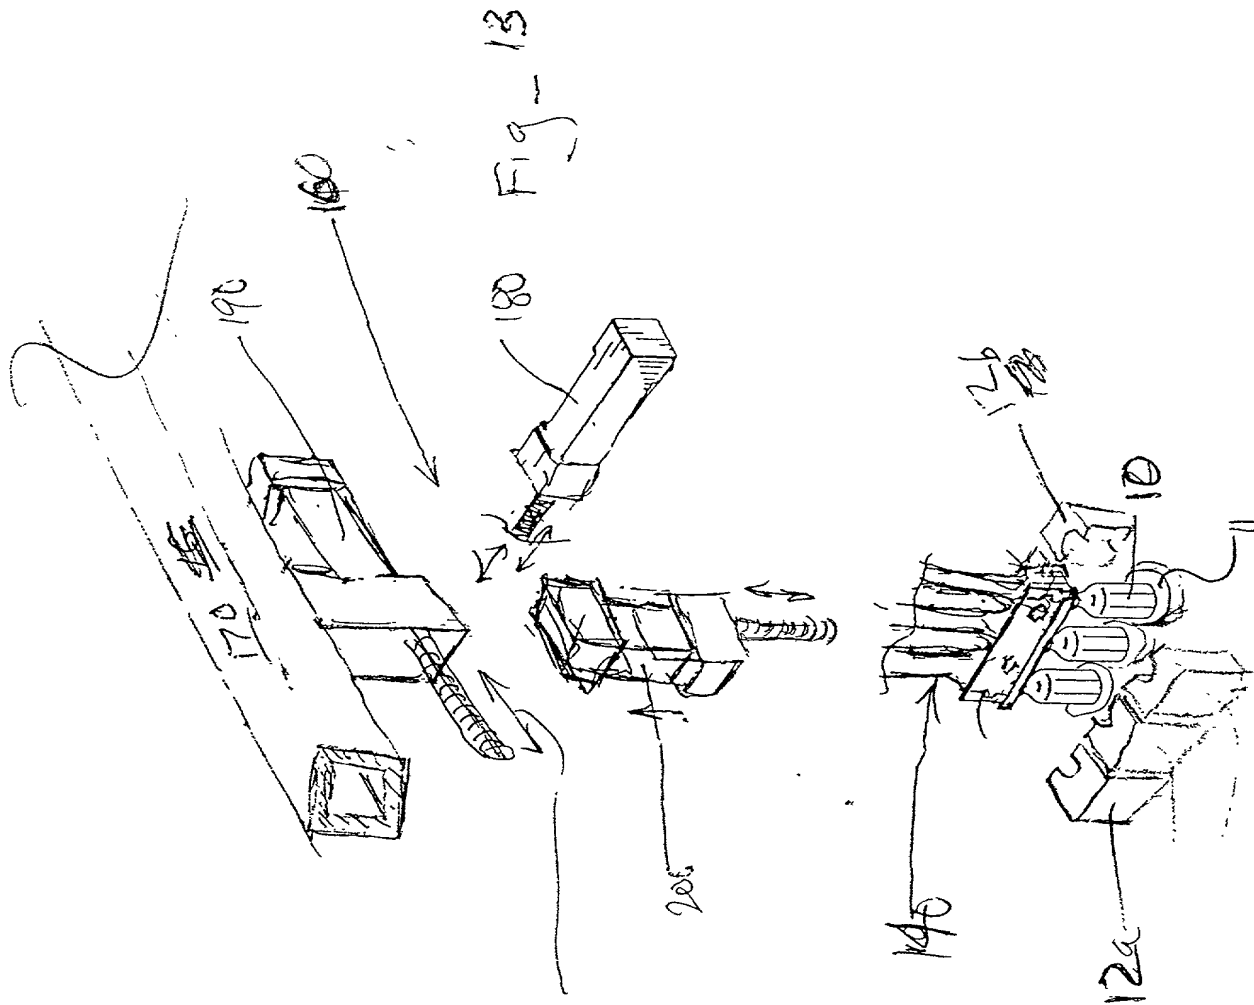

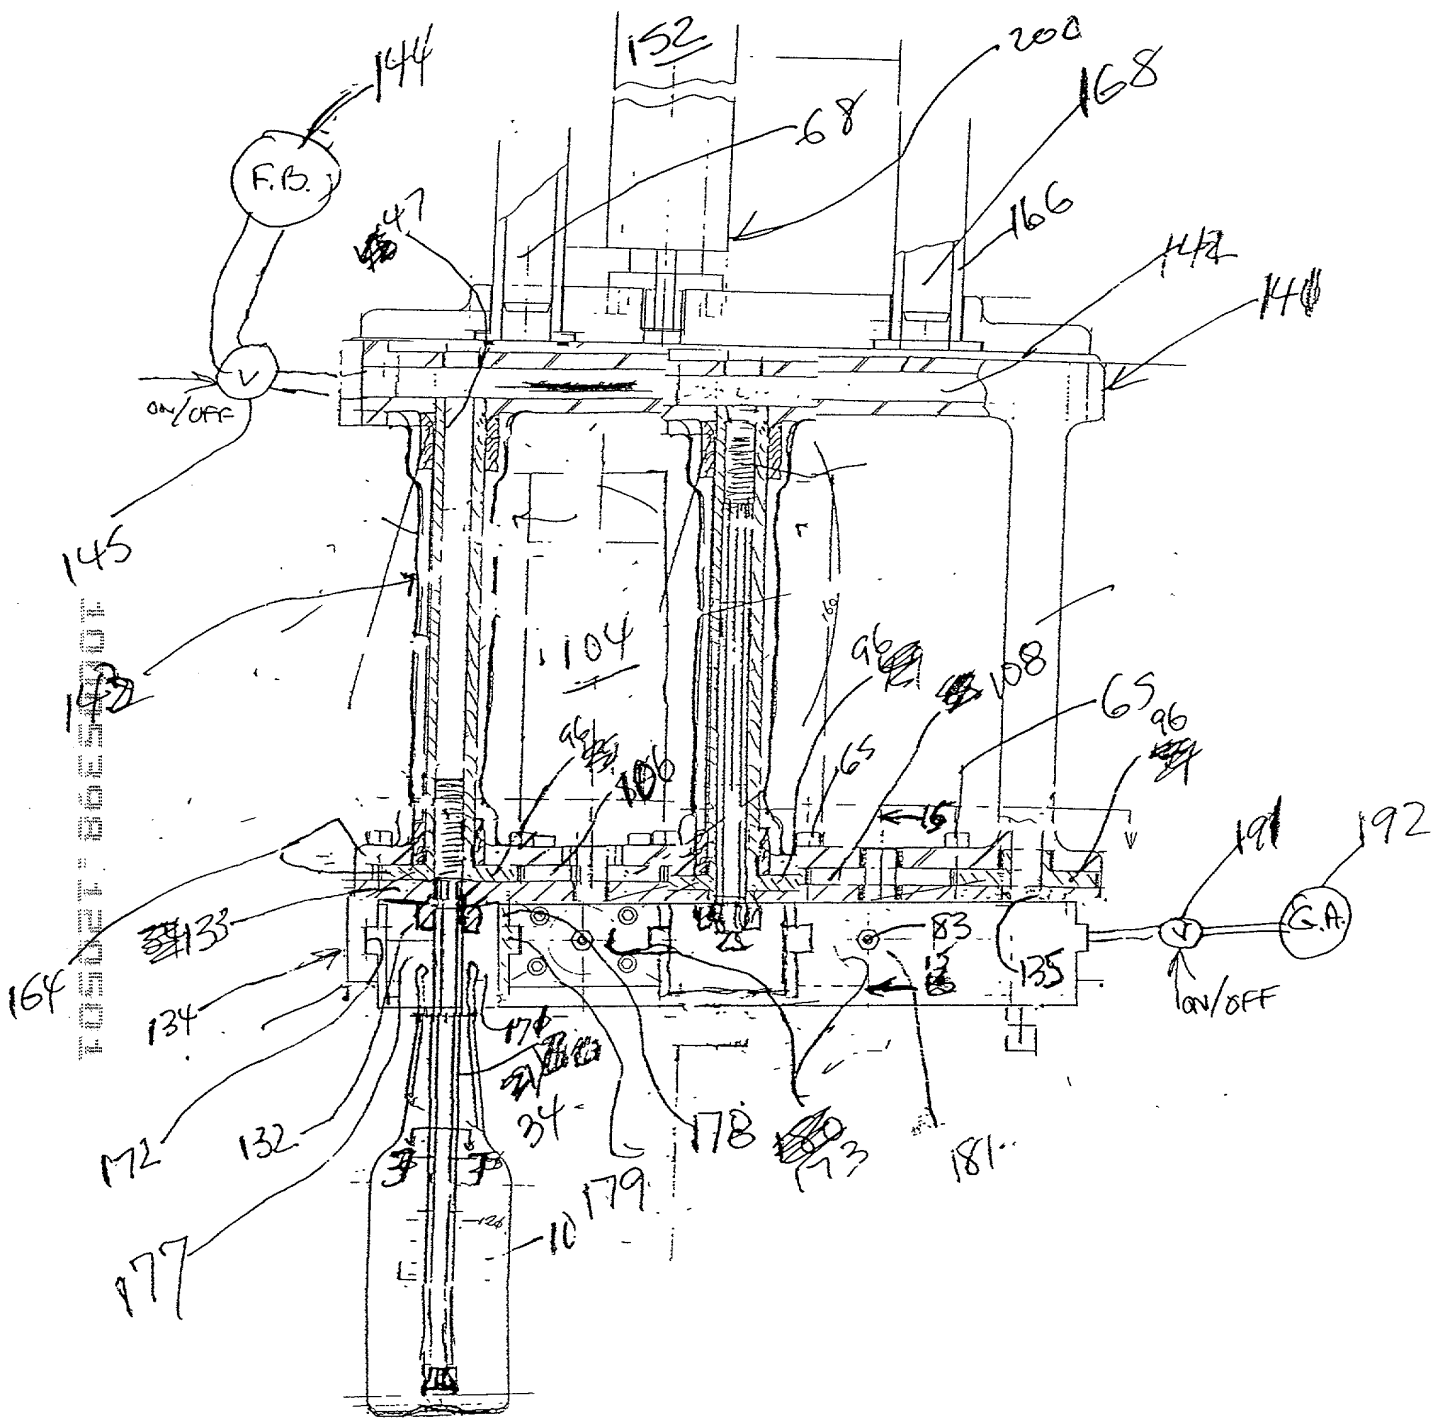
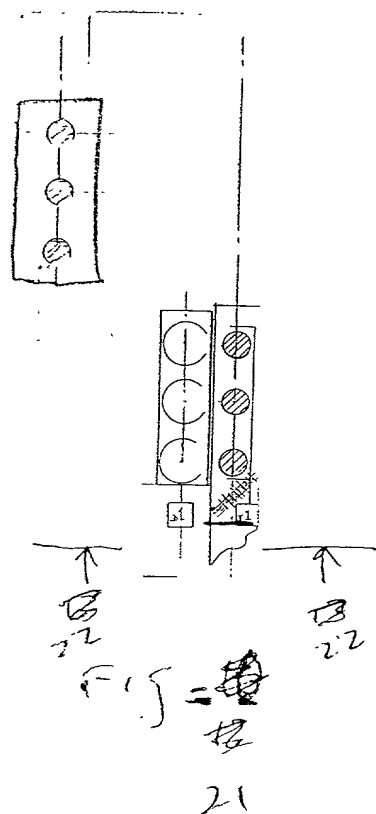
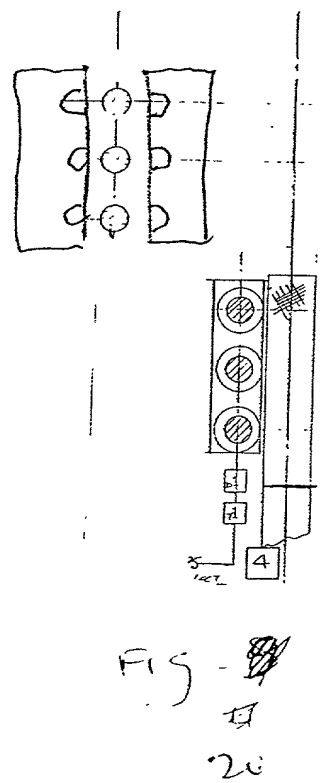
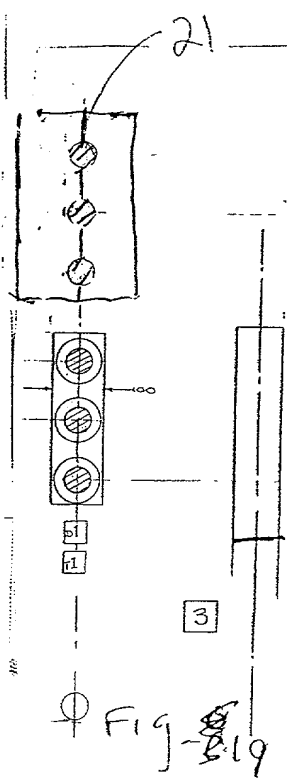
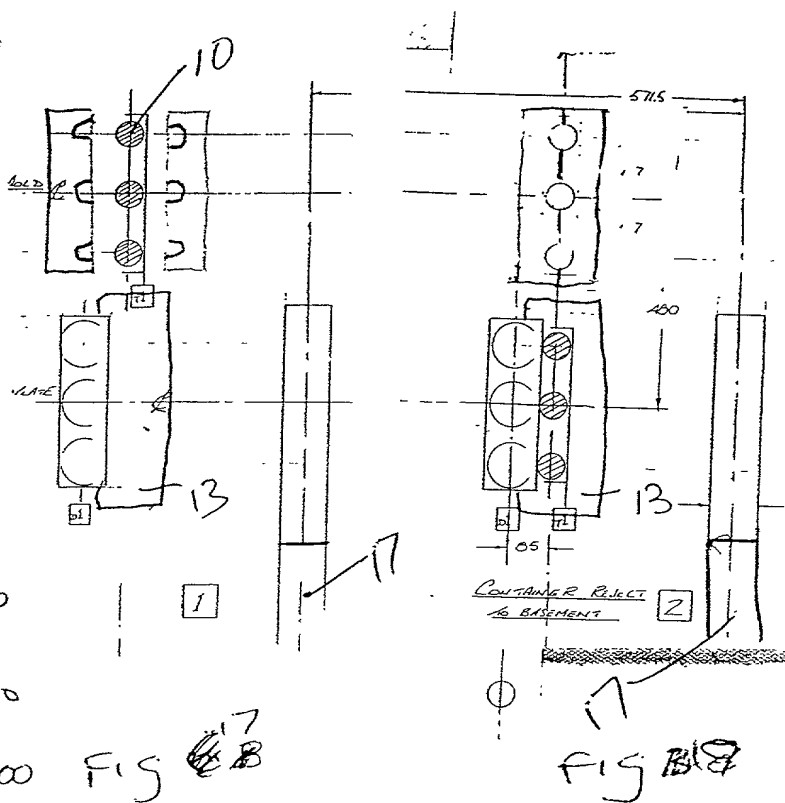
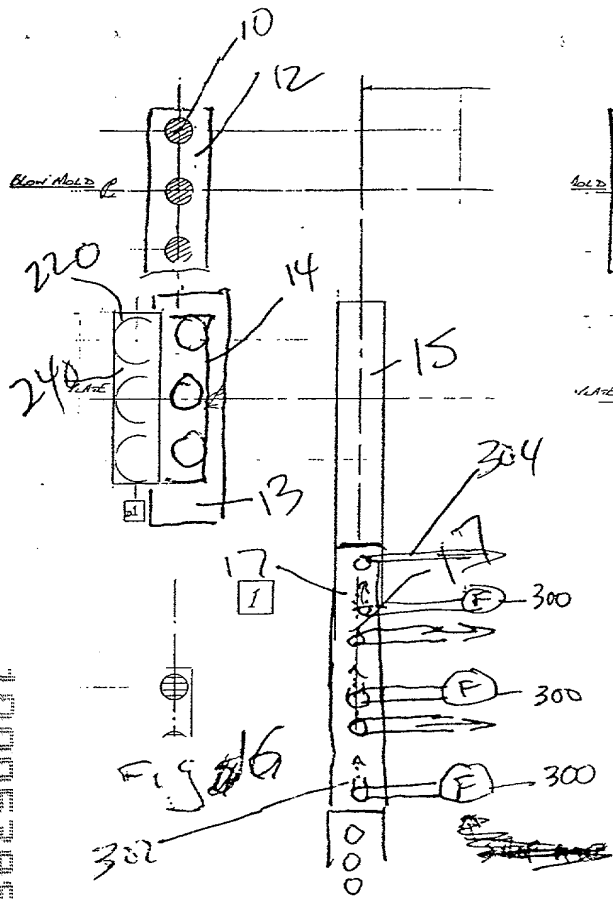


FIG - 14

FIG. 16



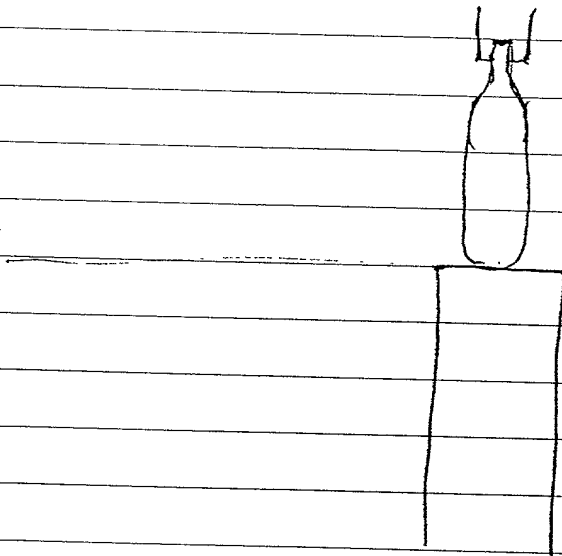
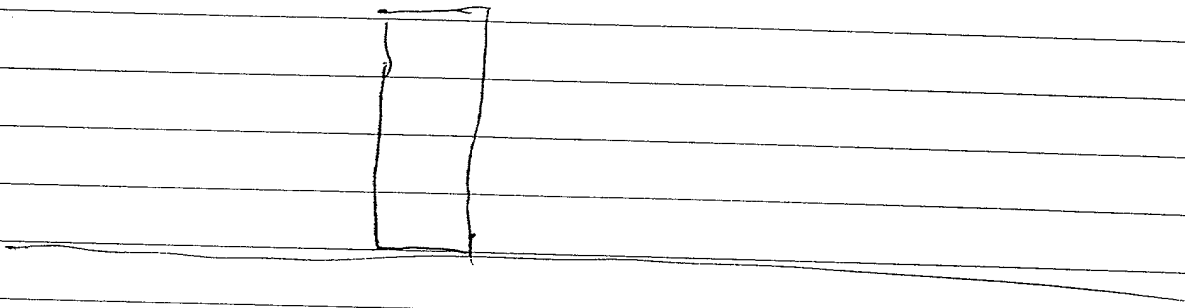


FIG ~~21~~ 22

FIGURE 10

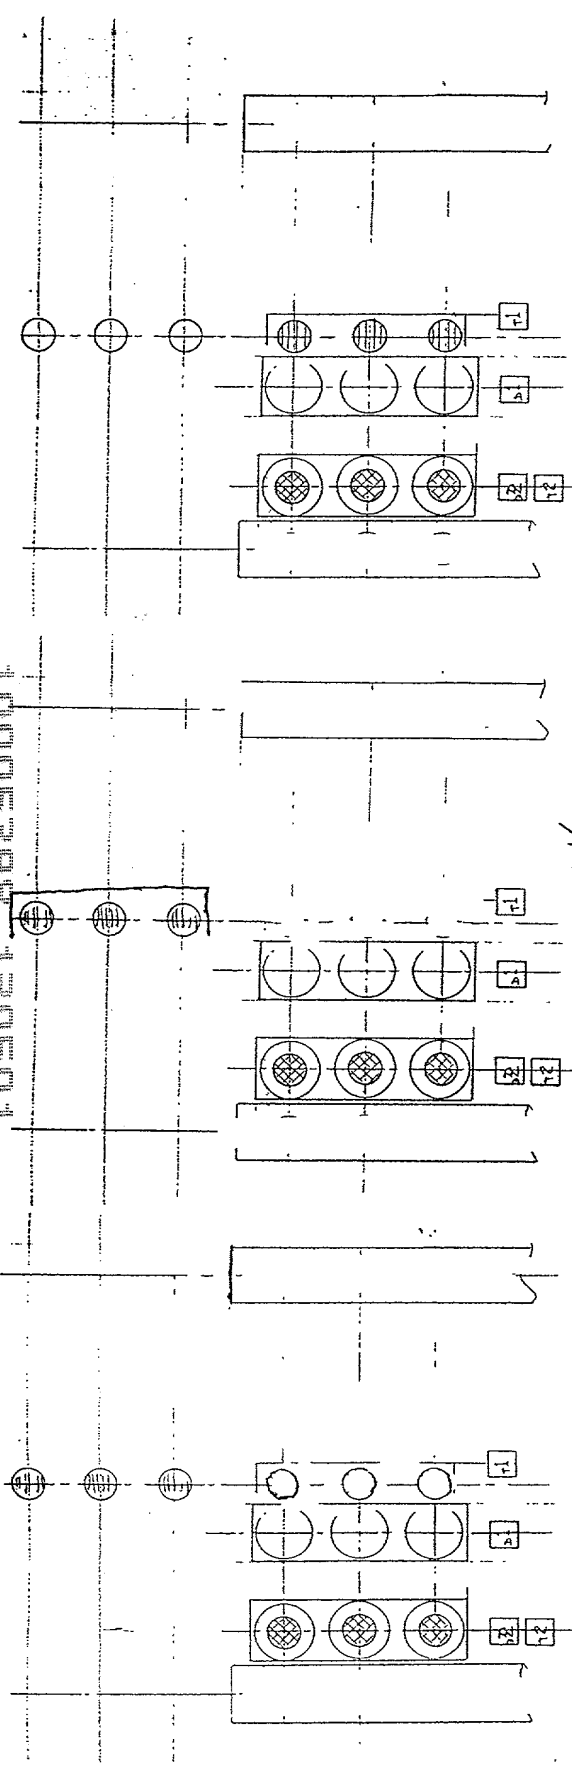


Fig-25

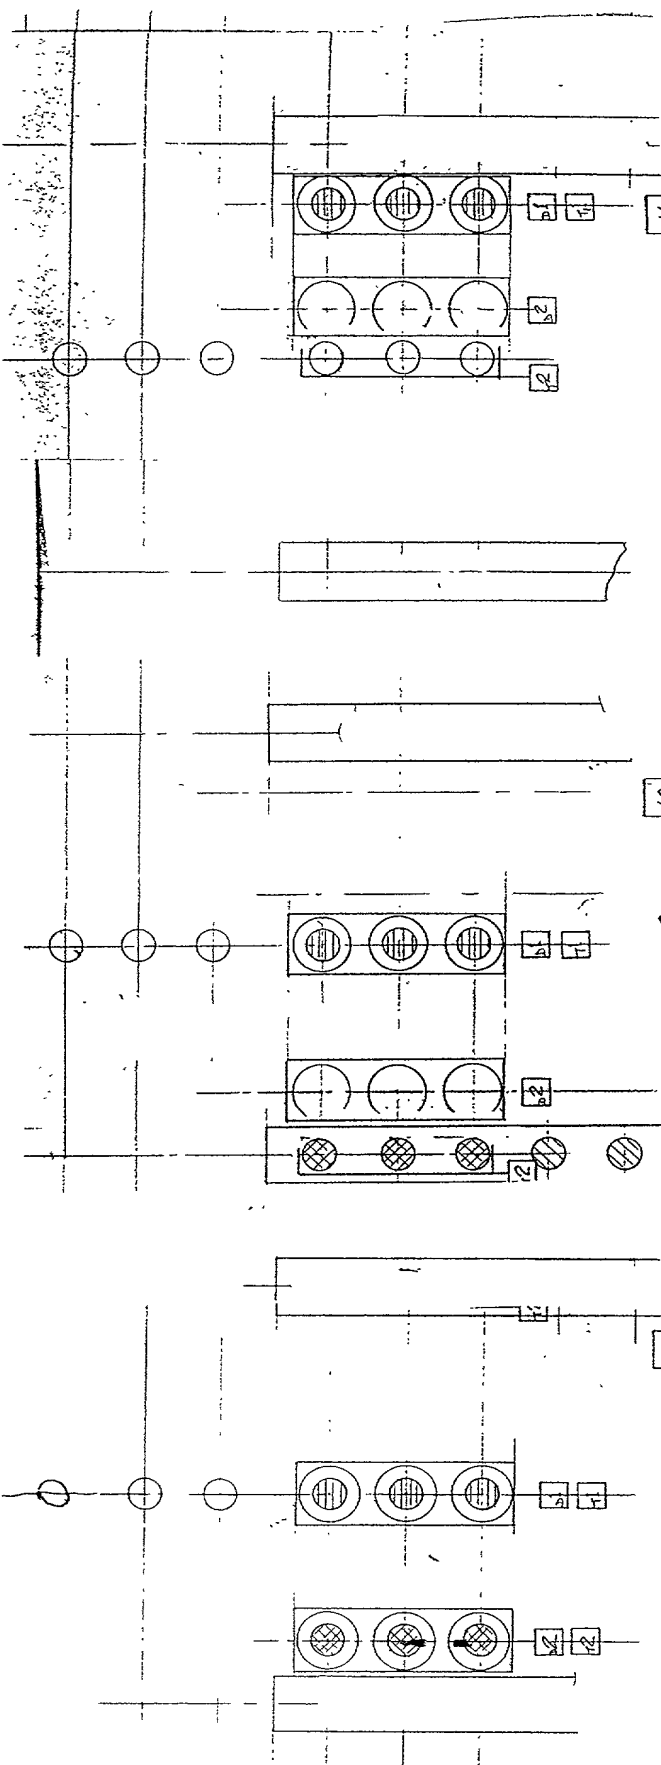


Fig-29

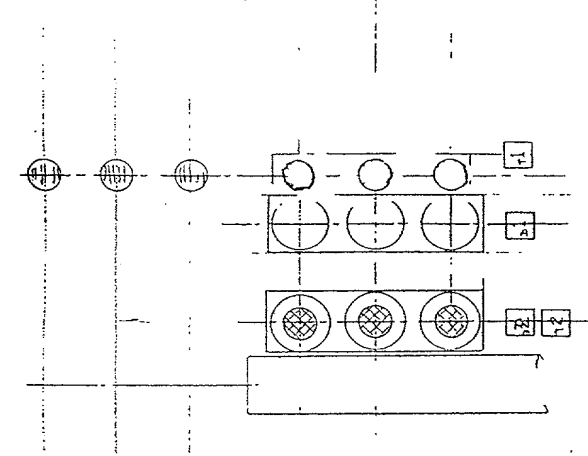


Fig-22

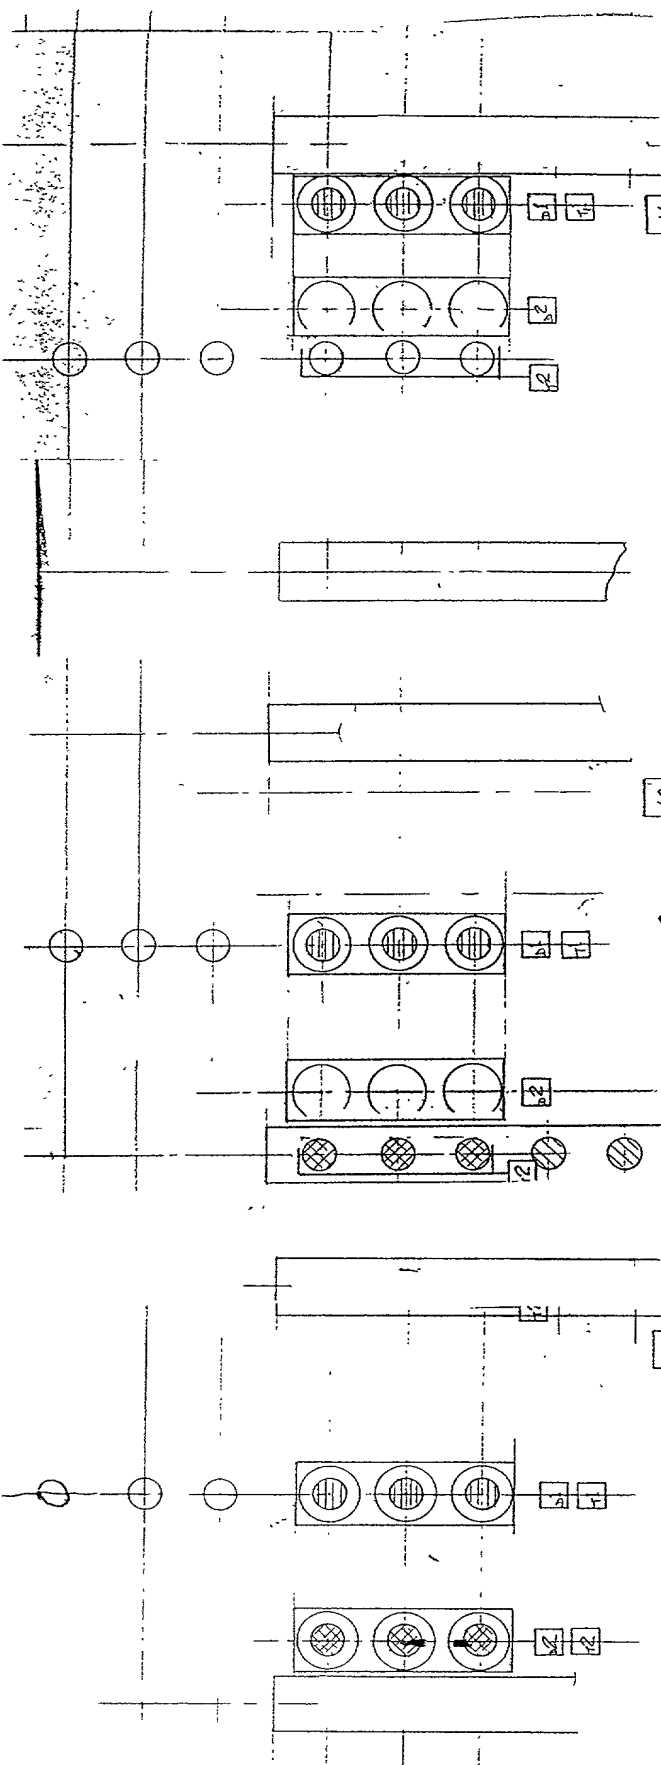


Fig-26

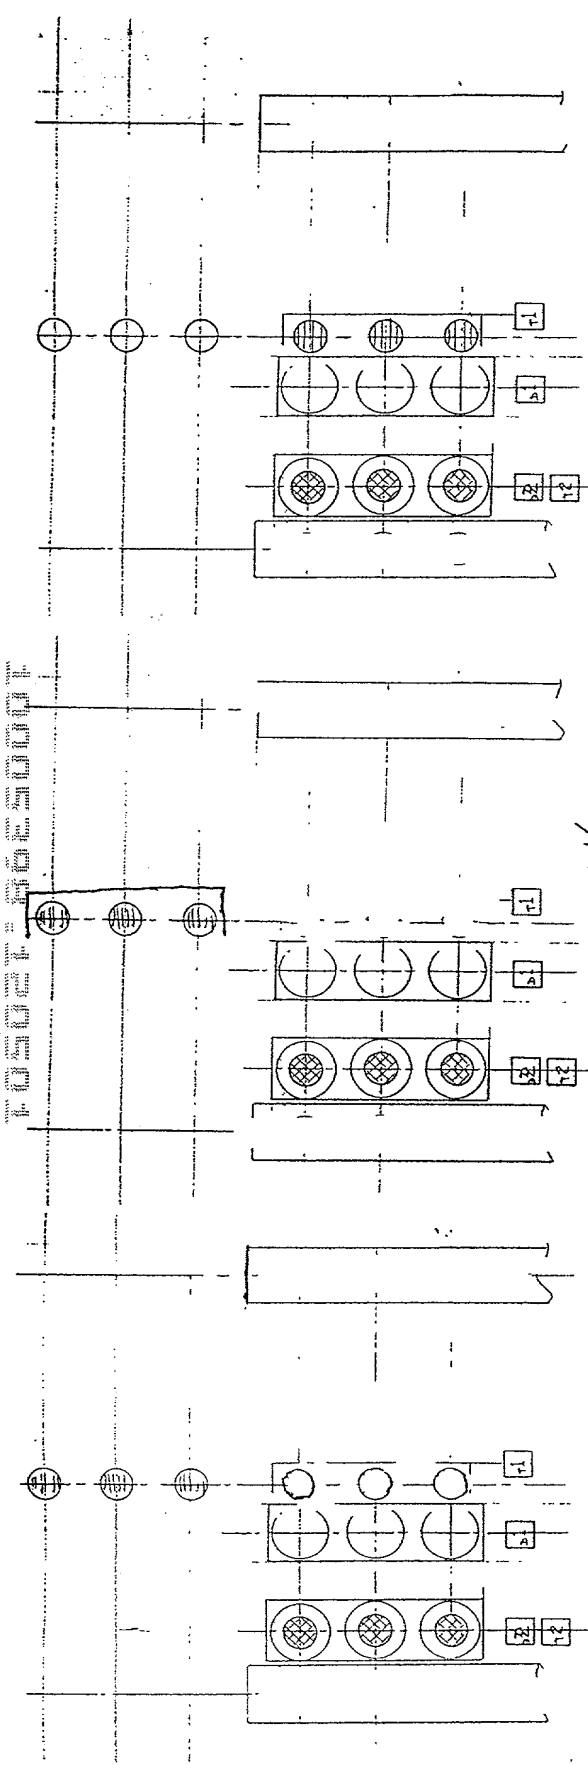


Fig-28

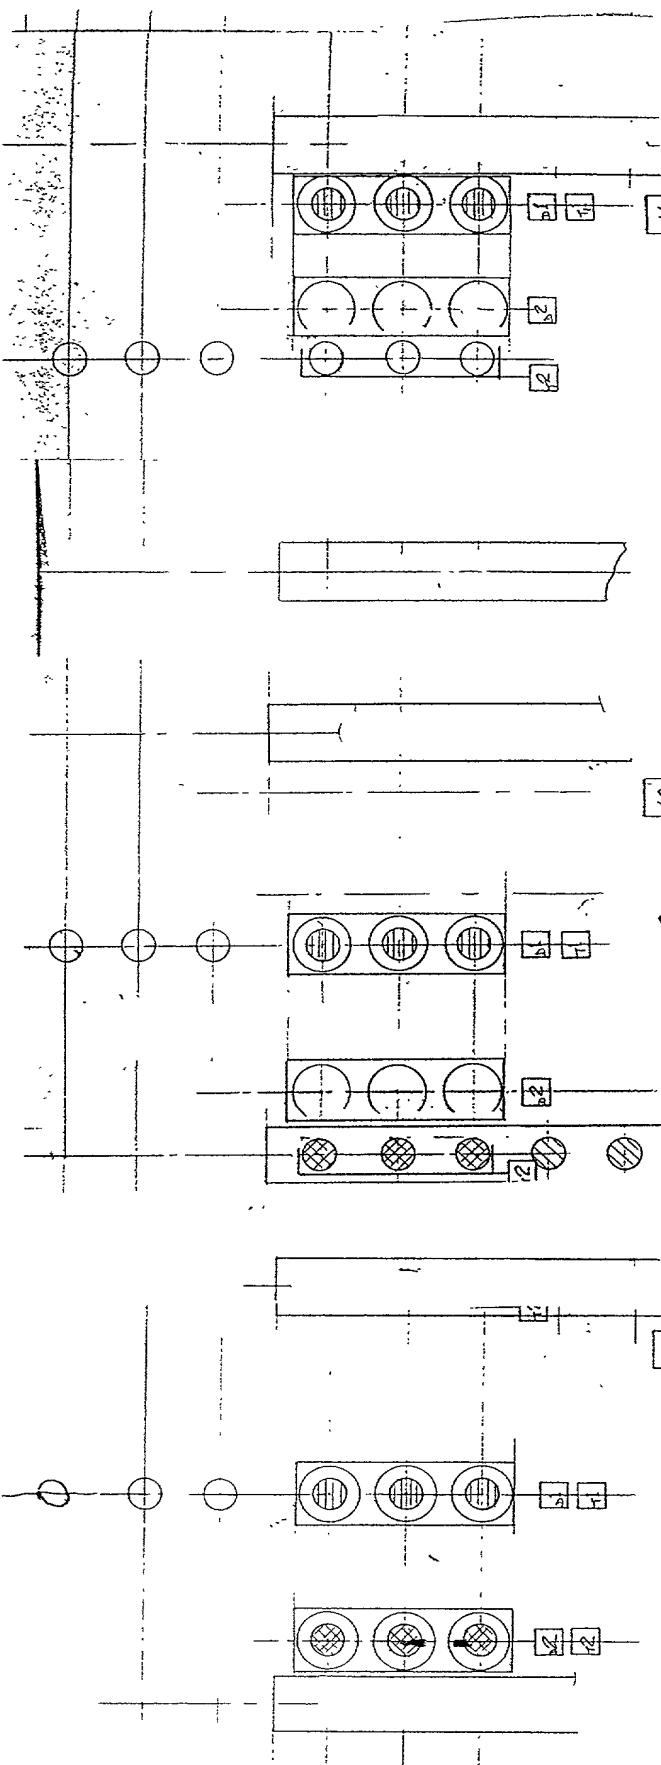
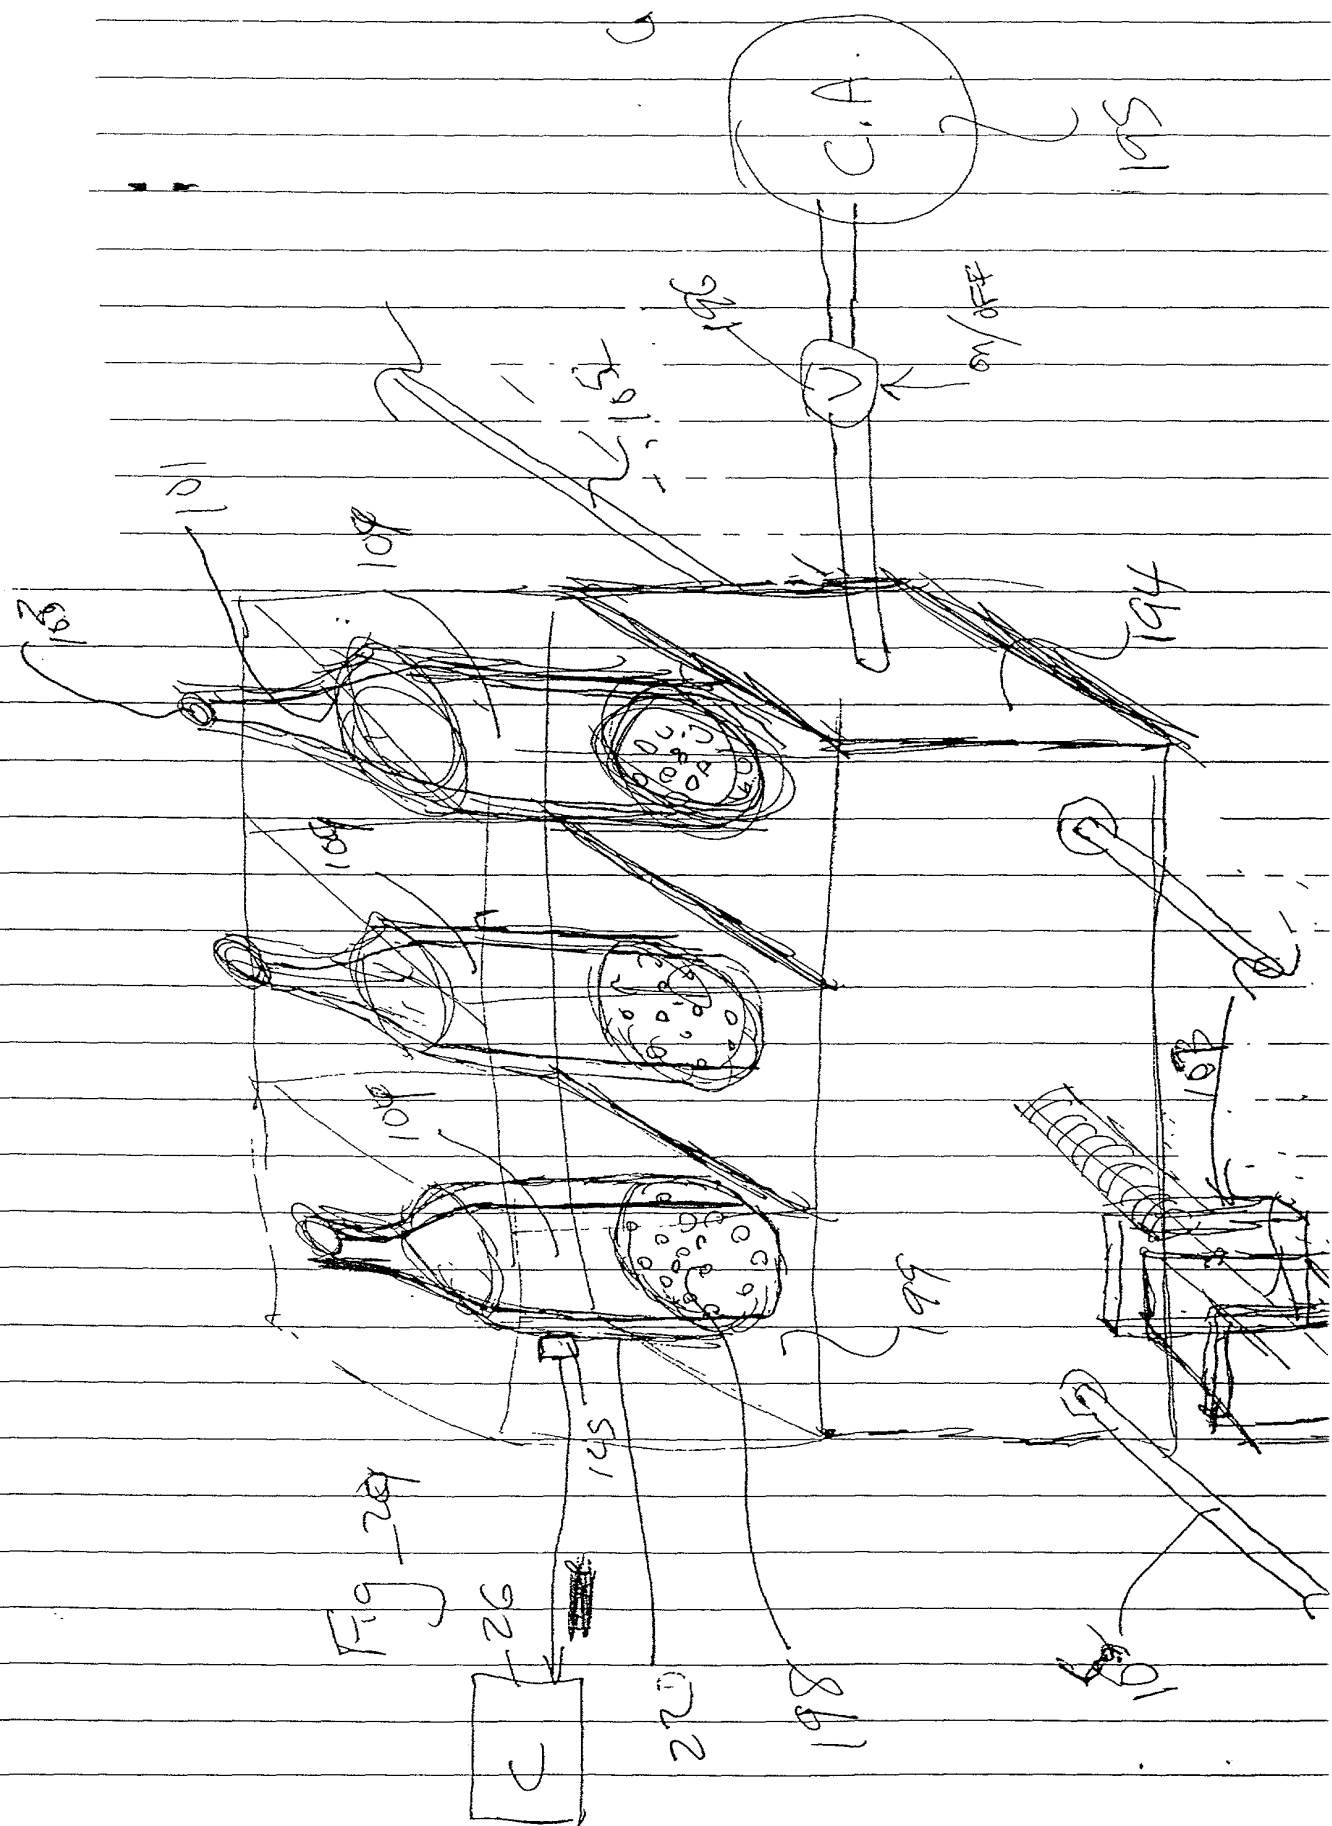


Fig-27

1000393-12000



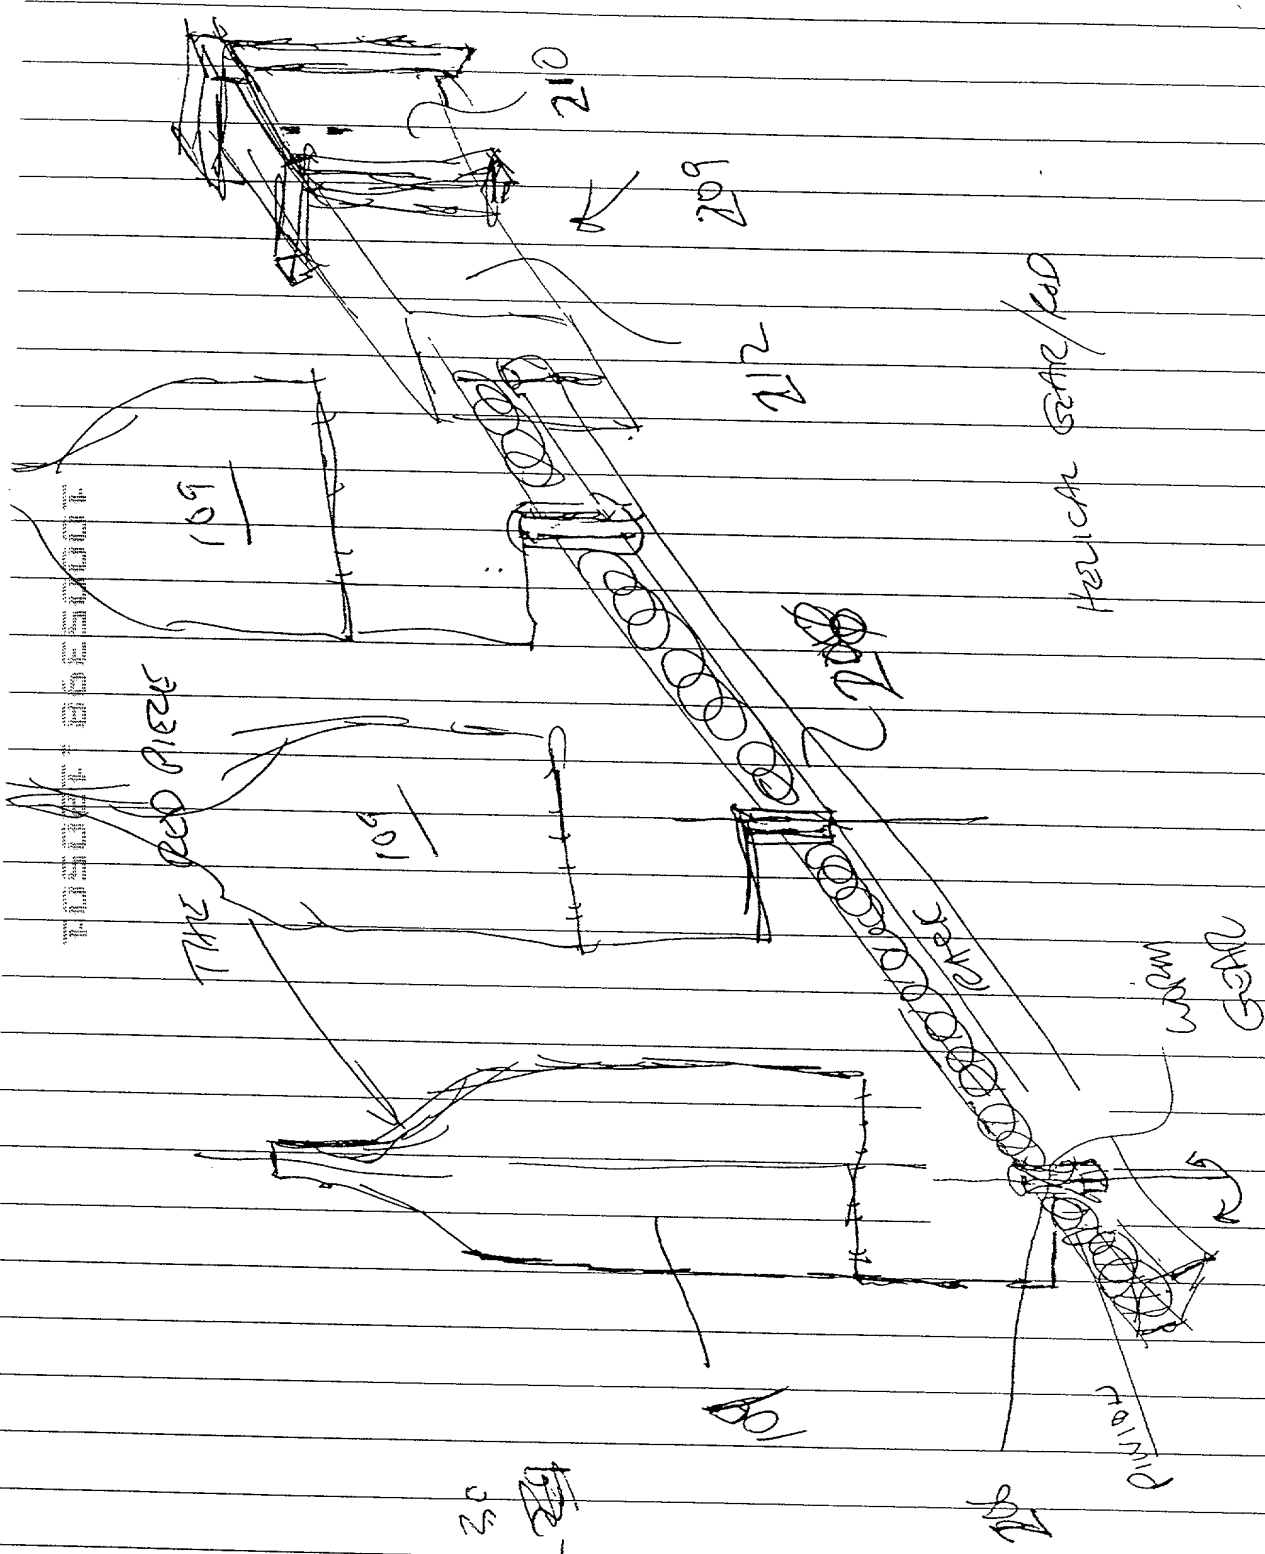


Fig - 209

End
The end

Brown

TAKEOUT ASSEMBLY
PEND PLATE
11/22 WITH 15"m

From
Mayer

Decision Tunnel